



This certificate is not valid if the serial number has been defaced or altered

40159943

ISN18.3c

# CONTINUATION SHEET : EIC and EICR

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## PART B : SCHEDULE OF TEST RESULTS (MUST reflect circuits entered into 'Schedule of Circuit Details' in Part A)

Circuit number	Continuity (Ω)					Insulation resistance			Polarity (✓)	Max. measured earth fault loop impedance, Z <sub>s</sub> (Ω)	RCD		AFDD**	Comments and additional information, where required
	Ring final circuits only (measured end to end)			All circuits (complete at least one column)		Live / Live	Live / Earth	Test voltage DC			Operating time*	Test button	AFDD test button	
	(Line) r <sub>1</sub>	(Neutral) r <sub>n</sub>	(cpc) r <sub>2</sub>	(R <sub>1</sub> + R <sub>2</sub> )	R <sub>2</sub>	(MΩ)	(MΩ)	(V)			(ms)	(✓)	(✓)	
7L1	N/A	N/A	N/A	Lim	N/A	Lim	Lim	N/A	✓	0.16	N/A	N/A	N/A	N/A
7L2	N/A	N/A	N/A	Lim	N/A	Lim	Lim	N/A	✓	0.18	N/A	N/A	N/A	N/A
7L3	N/A	N/A	N/A	Lim	N/A	Lim	Lim	N/A	✓	0.15	N/A	N/A	N/A	N/A
8L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
8L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
8L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
9L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	✓	N/A	N/A	N/A	N/A	N/A
9L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	✓	N/A	N/A	N/A	N/A	N/A
9L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	✓	N/A	N/A	N/A	N/A	N/A
10L1	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	✓	N/A	N/A	N/A	N/A	N/A
10L2	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	✓	N/A	N/A	N/A	N/A	N/A
10L3	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	✓	N/A	N/A	N/A	N/A	N/A
11L1	N/A	N/A	N/A	Lim	N/A	Lim	Lim	N/A	✓	0.16	N/A	N/A	N/A	N/A
11L2	N/A	N/A	N/A	Lim	N/A	Lim	Lim	N/A	✓	0.14	N/A	N/A	N/A	N/A
11L3	N/A	N/A	N/A	Lim	N/A	Lim	Lim	N/A	✓	0.15	N/A	N/A	N/A	N/A
12L1	N/A	N/A	N/A	Lim	N/A	Lim	Lim	N/A	✓	0.18	N/A	N/A	N/A	N/A
12L2	N/A	N/A	N/A	Lim	N/A	Lim	Lim	N/A	✓	0.18	N/A	N/A	N/A	N/A
12L3	N/A	N/A	N/A	Lim	N/A	Lim	Lim	N/A	✓	0.16	N/A	N/A	N/A	N/A

Circuits/equipment vulnerable to damage when testing (where applicable): All vulnerable equipment has been disconnected for testing

TESTED BY Name (capitals): GARETH PRITCHARD Position: Electrician Signature: Date: 08/09/2025

TEST INSTRUMENTS (ENTER SERIAL NUMBER AGAINST EACH INSTRUMENT USED)					
Multi-function: 28K-1011	Continuity: N/A	Insulation resistance: N/A	Earth fault loop impedance: N/A	Earth electrode resistance: N/A	RCD: N/A

\* RCD effectiveness is verified using an alternating current test at rated residual operating current (I<sub>Δn</sub>)

\*\* Where installed. Note, not all AFDDs have a test function. Where a circuit contains an AFDD this should be stated in the field for that circuit in the 'Comments and additional information, where required' column.

CODES for Type of wiring	(A) Thermoplastic insulated / sheathed cables	(B) Thermoplastic cables in metallic conduit	(C) Thermoplastic cables in non-metallic conduit	(D) Thermoplastic cables in metallic trunking	(E) Thermoplastic cables in non-metallic trunking	(F) Thermoplastic / SWA cables	(G) Thermosetting / SWA cables	(H) Mineral-insulated cables	Other (state): FP200
--------------------------	---	--	--	---	---	--------------------------------	--------------------------------	------------------------------	----------------------

Original (to the person ordering the work)



This certificate is not valid if the serial number has been defaced or altered

40159943

N18.3c

# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

### Operational Limitations

the running of the building e.g Fire Alarm, Lifts, CCTV etc.

Original (to the person ordering the work)

# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



Original (to the person ordering the work)

# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



Original (to the person ordering the work)

# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



Original (to the person ordering the work)

# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



Original (to the person ordering the work)

# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



Original (to the person ordering the work)

# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.




Original (to the person ordering the work)

# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.

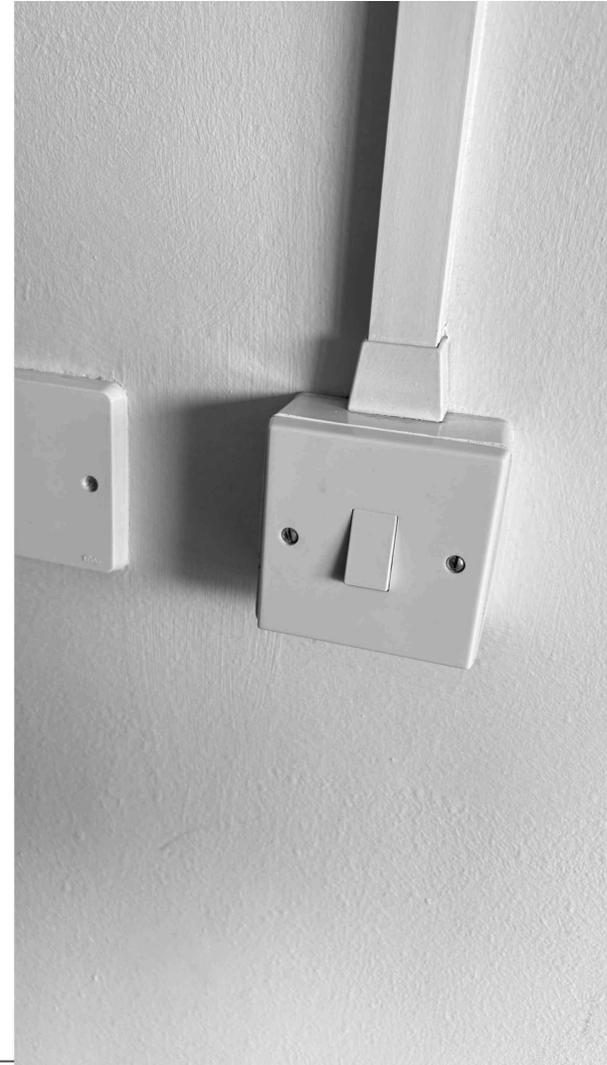

# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



Original (to the person ordering the work)

# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



Original (to the person ordering the work)

# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



Original (to the person ordering the work)

# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



Original (to the person ordering the work)

# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



Original (to the person ordering the work)

# GENERAL CONTINUATION SHEET

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

## NOTES

All remedial works completed are in pictures below following previous EICR.



Original (to the person ordering the work)

**GENERAL CONTINUATION SHEET**

Issued in accordance with BS 7671: 2018 (as amended) – Requirements for Electrical Installations

**NOTES**

All remedial works completed are in pictures below following previous EICR.



# NOTES FOR RECIPIENT

## THIS CONDITION REPORT IS AN IMPORTANT AND VALUABLE DOCUMENT WHICH SHOULD BE RETAINED FOR FUTURE USE

The purpose of periodic inspection is to determine, so far as is reasonably practicable, whether an electrical installation is in a satisfactory condition for continued service. This report provides an assessment of the condition of the electrical installation identified overleaf at the time it was inspected and tested, taking into account the stated extent of the installation and the limitations of the inspection and testing.

This report has been issued in accordance with the national standard for the safety of electrical installations, *BS 7671: 2018* (as amended) – Requirements for Electrical Installations.

The report identifies any damage, deterioration, defects and/or conditions found by the inspector which may give rise to danger (see PART 5), together with any items for which improvement is recommended.

You should have received the report marked 'Original' and the contractor should retain a duplicate. If you were the person ordering this report, but not the owner or user of the installation, you should pass this report, or a full copy of it, including these notes, the schedules and additional pages (if any), immediately to the owner or user of the installation.

This report should be retained in a safe place and shown to any person inspecting or undertaking further work on the electrical installation in the future. If you later vacate the property, this report will provide the new user with an assessment of the condition of the electrical installation at the time the periodic inspection was carried out.

For safety reasons, the electrical installation should be re-inspected at appropriate intervals by a skilled person or persons, competent in such work. NICEIC\* recommends that you engage the services of an NICEIC contractor for the inspection. Only an NICEIC contractor is authorised to issue this NICEIC Electrical Installation Condition Report, which has a unique serial number that is traceable to the contractor to which it was supplied by NICEIC.

The recommended date by which the next inspection should be carried out is stated in PART 4 of this report. With the exception of domestic (household) premises, there should also be a notice at or near the main switchboard or distribution board/consumer unit indicating when the next inspection of the installation is due.

This report is intended to be issued only for the purpose of reporting on the condition of an existing electrical installation and must not be issued to certify new electrical installation work including the replacement of a distribution board or consumer unit.

The report consists of at least eight numbered pages. The report is only valid if the Schedule of Items Inspected (PART 9) has been completed to confirm that all relevant inspections have been carried out and the Schedule of Circuit Details (PART 11A) and the Schedule of Test Results (PART 11B) are attached. For installations having more than one distribution board (or consumer unit) or more circuits than can be recorded in PARTS 11A & 11B, one or more additional Schedule of Circuit Details and Schedule of Test Results, should form part of the report. Additional numbered pages may have been provided to permit further relevant information relating to the installation to be recorded. The report is invalid if any of the additional pages, listed in PART 10 are missing.

Where the installation includes a residual current device (RCD) it should be tested every six months by pressing the button marked "T" or "Test". The device should switch off the supply and should then be switched on to restore the supply. If the device does not switch off the supply when the button is pressed, seek expert advice. For safety reasons it is important that this instruction is followed.

Where the installation includes an arc fault detection device (AFDD) having a manual test facility it should be tested six-monthly by pressing the test button. Where an AFDD has both a test button and automatic test function, manufacturer's instructions should be followed with respect to test button operation.

Where the installation includes a surge protection device (SPD) the status indicator should be checked to confirm it is in operational condition in accordance with manufacturer's information. If the indication shows that the device is not operational, seek expert advice.

Where the installation can be supplied by more than one source, such as the public supply and a standby generator or microgenerator, this should be identified in PART 7 Supply Characteristics and Earthing Arrangements, and the Schedules of Circuit Details and Schedule of Test Results (PARTS 11A & 11B) compiled accordingly.

PART 6 (Details and limitations) should identify fully the extent of the installation covered by this report and any limitations on the inspection and testing. The inspector should have agreed these aspects with the person ordering the report and with other interested parties (licensing authority, insurance company, mortgage provider and the like) before the inspection was carried out.

Operational limitations may have been encountered during the inspection such as inability to gain access to parts of the installation or to an item of equipment. The inspector should have noted any such limitations in PART 6. It should be noted that the greater the limitations applying to a report, the less its value from the safety aspect.

A declaration should have been given by the inspector in PART 4 of the report. The declaration must reflect the statement given in PART 3, which summarises the observations and recommendations made in PART 5. Where one or more observations have been made in PART 5, the Classification code given to each by the inspector indicates the degree of urgency with which remedial action needs to be taken to restore the installation to a safe working condition.

Where the inspector has indicated an observation as code C1 (danger present) the safety of those using the installation is at risk. Wherever practicable, items classified as C1 should be made safe on discovery, and it is recommended that a skilled person(s) competent in electrical installation work undertakes the necessary remedial work immediately.

Where the inspector has indicated an observation as code C2 (potentially dangerous) the safety of those using the installation may be at risk, and it is recommended that a skilled person competent in electrical installation work undertakes the necessary remedial work as a matter of urgency.

Where the inspector has indicated that an item requires further investigation (FI), the investigation should be carried out without delay to determine whether danger or potential danger exists. For further guidance on the Classification codes, please see the reverse of page 2.

Where inadequacies in the intake equipment have been observed (Item 1 of PART 9), the person ordering the inspection should inform the distributor and/or supplier as appropriate.

Should the person ordering this report have reason to believe that it does not reasonably reflect the condition of the electrical installation reported on, that person should in the first instance raise the specific concerns in writing with the contractor. If the concerns remain unresolved, the person ordering this report may make a formal complaint to NICEIC, for which purpose a complaint form is available on request.

The complaints procedure offered by NICEIC is subject to certain terms and conditions, full details of which are available upon application. NICEIC does not investigate complaints relating to the operational performance of electrical installations (such as lighting levels), or to contractual or commercial issues (such as time or cost).

For further information about electrical safety and how NICEIC can help you, visit:

[www.niceic.com](http://www.niceic.com)

\* NICEIC is operated by Certsure LLP, a partnership between the Electrical Contractors' Association and the charity, Electrical Safety First. NICEIC maintains and publishes registers of electrical contractors that it has assessed against particular scheme requirements (including the technical standard of electrical work).

# GUIDANCE FOR RECIPIENTS ON THE CLASSIFICATION CODES

## ONLY ONE CLASSIFICATION CODE SHOULD BE GIVEN FOR EACH RECORDED OBSERVATION

### Classification code C1 (Danger present)

Where an observation has been given a Classification code C1, the safety of those using the installation is at risk and immediate remedial action is required.

The person responsible for the maintenance of the installation is advised to take action without delay to remedy the observed deficiency in the installation, or to take other appropriate action (such as switching off and isolating the affected part(s) of the installation) to remove the danger. The NICEIC contractor issuing this report will be able to provide further advice.

NICEIC makes available 'Electrical Danger Notification' forms to enable inspectors to record, and then to communicate to the person ordering the report, any dangerous condition discovered.

### Classification code C2 (Potentially dangerous)

Classification code C2 indicates that, whilst those using the installation may not be at immediate risk, urgent remedial action is required to remove potential danger. The NICEIC contractor issuing this report will be able to provide further advice.

It is important to note that the recommendation given for the next inspection date in PART 4 of this report is conditional upon all items which have been given a Classification code C1 and code C2 being remedied immediately and as a matter of urgency, respectively.

It would not be reasonable for the inspector to indicate that the installation is in a satisfactory condition if any observation in this report has been given a code C1 or code C2 classification.

### Classification code C3 (Improvement recommended)

Where an observation has been given a Classification code C3, the inspection and/or testing has revealed a non-compliance with the current safety standard which, whilst not presenting immediate or potential danger, would result in a significant safety improvement if remedied. Careful consideration should be given to the safety benefits of improving these aspects of the installation. The NICEIC contractor issuing this report will be able to provide further advice.

### Code FI (Further investigation required without delay)

It should usually be possible for the inspector to attribute a Classification code to each observation without indicating a need for further investigation.

However, where 'FI' has been entered against an observation the inspector considers that further investigation of that observation is likely to reveal danger or potential danger that, due to the agreed extent or limitations of the inspection and/or testing (entered in PART 6), could not be fully identified at the time.

It would not be appropriate for the inspector to indicate that the installation is in a satisfactory condition if there is reasonable doubt as to whether danger or potential danger exists. Consequently, where the inspector has indicated 'Further investigation required without delay' (FI) the overall assessment of the installation (PART 3) should be marked as 'Unsatisfactory.'

If the inspector has indicated that an observation requires further investigation without delay, the person ordering this report is advised to arrange for the NICEIC contractor issuing the report (or another skilled person or persons competent in such work) to undertake further examination of that aspect of the installation as a matter of urgency, to determine whether or not danger or potential danger exists.

### Further information

Further information on the application of Classification codes, primarily aimed at inspectors but of possible interest to persons ordering condition reports, can be found in Electrical Safety First's Best Practice Guide No 4 *Electrical installation condition reporting: Classification Codes for domestic and similar electrical installations*. The guide can be viewed or downloaded free of charge from [www.electricalsafetyfirst.org.uk](http://www.electricalsafetyfirst.org.uk)

For further information about electrical safety and how NICEIC can help you, visit  
[www.niceic.com](http://www.niceic.com)